




#116837



BILL GARRISON, SET  
LEVEL IV  
FIRE ALARM SYSTEMS

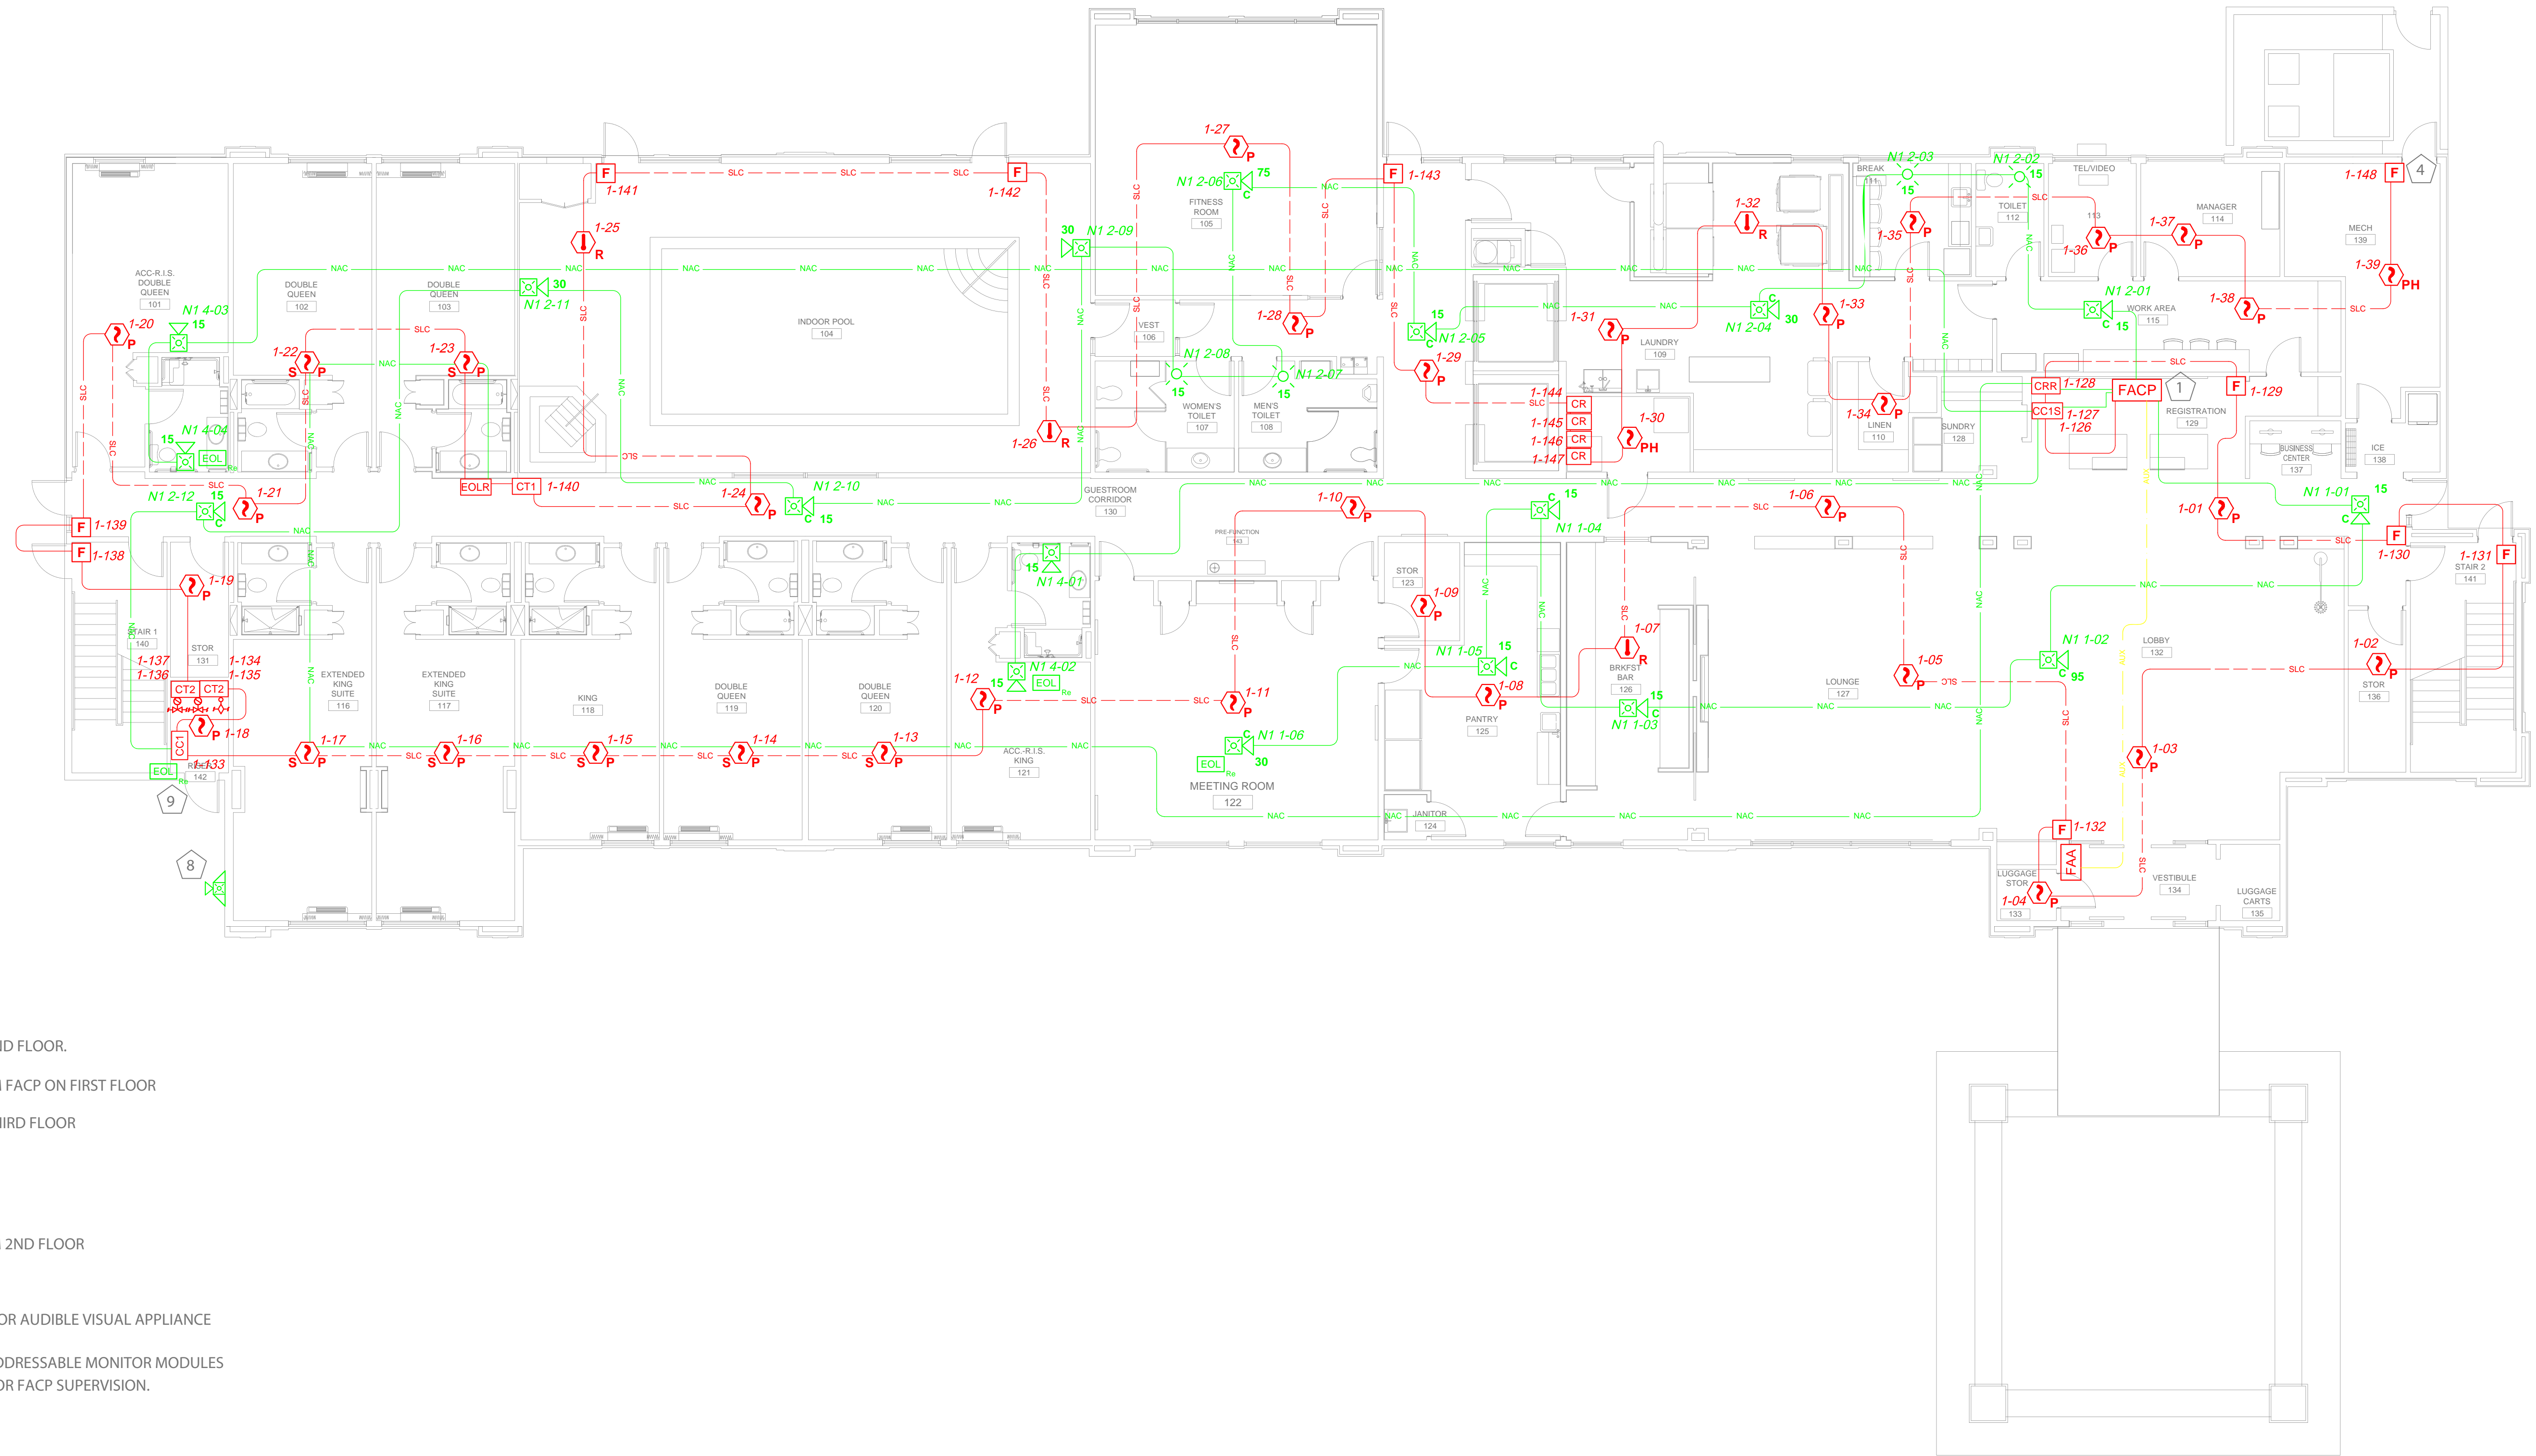

- 1 SLC CIRCUIT # 2 TO 2ND FLOOR.
- 2 SLC CIRCUIT # 2 FROM FACP ON FIRST FLOOR
- 3 SLC CIRCUIT # 2 TO THIRD FLOOR
- 4 SLC CIRCUIT # 1 END
- 5 SLC CIRCUIT # 2 END
- 6 SLC CIRCUIT # 2 FROM 2ND FLOOR
- 7 SLC CIRCUIT # 2 END
- 8 FIELD LOCATE EXTERIOR AUDIBLE VISUAL APPLIANCE
- 9 IF FIRE PUMP USED ADDRESSABLE MONITOR MODULES WILL BE INSTALLED FOR FACP SUPERVISION.

### FIRST FLOOR

SCALE: 1/8" = 1'

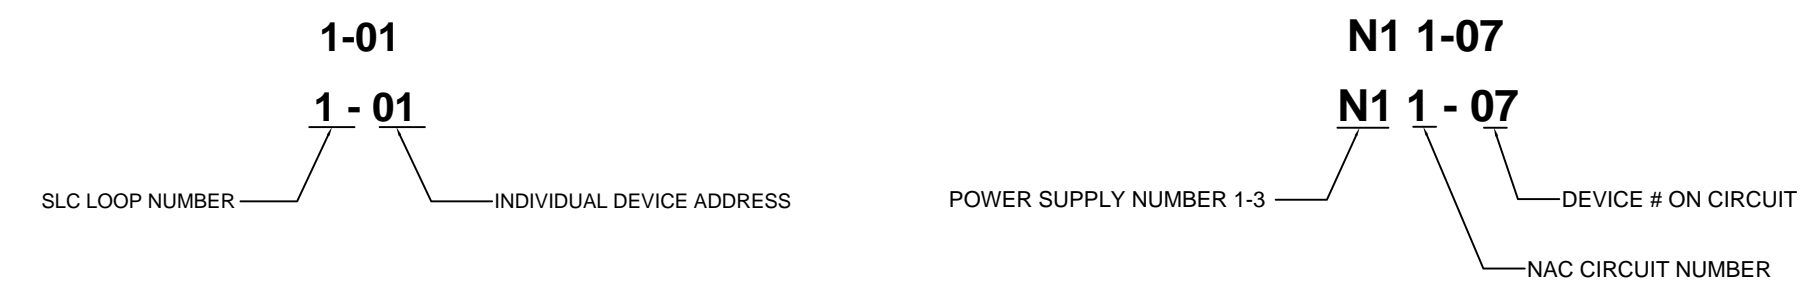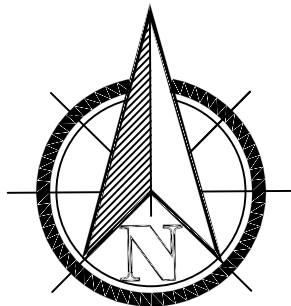

WIRE SCHEDULE	
SIGNALING LINE CIRCUIT (SLC)	ALL WIRING IS CLASS B --- SLC --- SLC
NOTIFICATION APPLIANCE CIRCUIT (NAC)	--- NAC --- NAC
AUXILIARY POWER CIRCUIT	--- AUX --- AUX
REMOTE TEST CIRCUIT	--- RTS --- RTS
	◆ #18 - 2 FPLP
	◆ #14 - 2 FPLP
	◆ #16 - 2 FPLP
	◆ #18 - 2 FPLP
	*Minimum Conductor Size
	*As required by N.E.C. 760-31 for low voltage power circuits as well as manufacturer's recommendations

SYSTEM INSTALLER:

YOUR COMPANY  
1234 S. SOMEWHERE STREET  
PEORIA, ILLINOIS 61610  
PHONE: 123.456.7890  
FAX: 123.456.7890  
www.yourwebsite.com

YOUR COMPANY  
LOGO HERE



DATE OF REVISION  
14 JAN 2014  
PROJECT #  
0-000000  
SHEET DESCRIPTION  
FIRST FLOOR PLAN  
DEVICE LAYOUT  
SHEET NUMBER

# FA-2